

MQ Power V3 One Link Install

Parts list:

- (1) One Link with magnetic mounts
- (1) 4G LTE Antenna/GPS Antenna
- (2) Lever wire connectors

- (1) Battery wiring harness with inline fuse
- (1) OLSC005 serial cable
- (2) Zip ties

Installation Instructions:


- 1. Put the generator in stop mode.
- 2. Disconnect the positive battery terminal. (Do not reconnect the positive battery terminal until step 18.)
- 3. Using the magnetic mounts, mount the One Link inside of the generator enclosure close to the controller. (Be sure the mounting location is away from weather exposure.)
- 4. Connect the ring connector on the red wire of the battery wiring harness to the positive (+) battery terminal.
- 5. Connect the ring connector on the **black** wire of the battery wiring harness to the negative (-) battery terminal.
- 6. Route the brown wire, orange wire, and blue wire from the One Link I/O cable to the battery wiring harness installed in steps 4 and 5.
- 7. Using one of the included lever wire connectors, connect the bare **black** wire from the battery wiring harness to the orange wire and blue wire from the One Link I/O cable.
- 8. Using one of the included lever wire connectors, connect the bare red wire from the battery wiring harness to the bare brown wire from the One Link I/O cable.
- 9. Route the black wire from the One Link I/O cable to Terminal 6.
- 10. Route the white wire from the One Link I/O cable to Terminal 7.
- 11. Route the purple wire from the One Link I/O cable to Terminal 8.
- 12. Route the brown wire with white stripe from the One Link I/O cable to Terminal 21.
- 13. Route the red wire with white stripe from the One Link I/O cable to Terminal 23.
- 14. Route the green wire from the One Link I/O cable to Terminal 30.
- 15. Mount the LTE/GPS antenna on the top of the generator.
- 16. Connect the LTE antenna cable to the top connector on the right side of the One Link.
- 17. Connect the GPS antenna cable to the bottom connector on the right side of the One Link.
- 18. Reconnect the positive battery terminal to the battery.





At this time the One Link will power up and begin communicating with the generator. Please allow 5-10 minutes for the One Link to establish a connection to the internet, and then check the activation screen or your One Link account to ensure the generator's vitals update and the One Link is transmitting data.



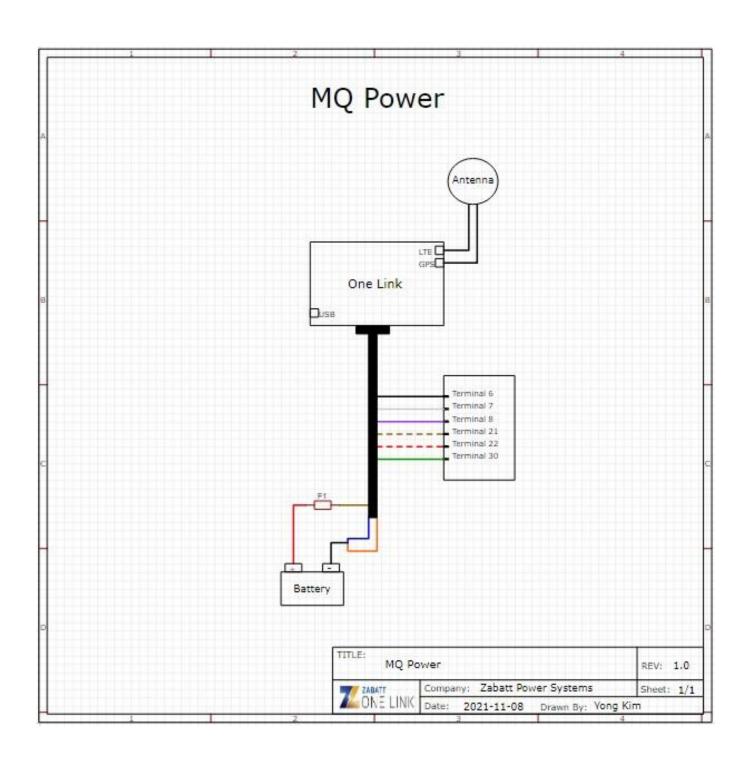



MQ Power One Link Wire Legend						
				New Black I/O Cable Color	Generator	
Description	Illustration	One Link Function	Color		Location	Generator Function
Battery +		Battery +	Red	Brown	Battery +	Battery +
Battery -	_	Battery -	Black	Blue	Battery -	Battery -
K1COM	****	K1COM	Red/White Stripe	Orange	Battery -	Remote Start
K1NO	-	K1NO	Red/Black Stripe	Green	Terminal 30	
K2COM		K2COM	Orange	Yellow	36	
K2NC	***	K2NC	Orange/Black Stripe	Gray	£6	0
DI1		Close to Ground	Black/White Stripe	Pink		
DI2	-	Close to Ground	Blue/Black Stripe	Red	(0	1
DI3	1885	Close to Batt +	Blue/White Stripe	Black	Terminal 6	Common Warning
DI4		Close to Batt +	Blue	White	Terminal 7	Common Shutdown
DI5	***	Close to Batt +	Green/Black Stripe	Purple	Terminal 8	Low Fuel Level
A1		0-5V	Green	Light Green		
A2	****	0-5V	Green/White Stripe	Black/White Stripe	86	
L1		AC Voltage L1	White	Brown/White Stripe	Terminal 21	AC Voltage Sensing(Includes Hz and RPM
L2	111	AC Voltage L2	White/Black Stripe	Red/White Stripe	Terminal 23	